


7.00 [178]

Bottom View

Rev. No.	Revision Note	Date	Ву	Checked
A21	Capacitors Revised	04-MAR-15	АН	YM
A22	CHANGED E1 ENCLOSURE TO SU1	30-NOV-15	CG	АН

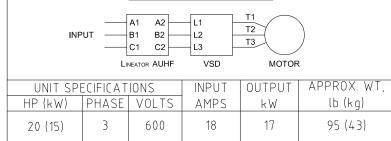



Connection Diagram

NOTES:

1. CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES AND OTHER APPLICABLE ELECTRICAL SAFETY AUTHORITIES.

2. CUSTOMER IS RESPONSIBLE FOR PROPER COOLING OF FILTER COMPONENTS. ALLOWED AMBIENT: MAXIMUM 60°C, MINIMUM -40°C. A MINIMUM CLEARANCE OF 2" MUST BE ALLOWED ON BOTH RIGHT AND LEFT SIDES. PROPER VENTILATION MUST ENSURE THAT SUPPLY AIR FLOWS THROUGH THE REACTOR COILS FROM BELOW THE UNIT.

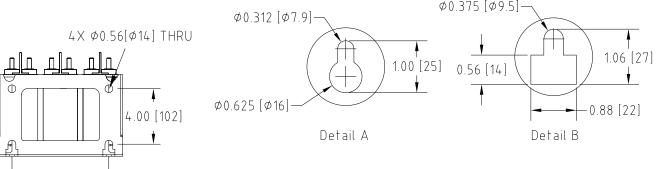



Input A1,B1,C1 & Output A2,B2,C2
TERMINALS
THICKNESS: 1 /8"

THICKNESS: 1/8"

Checked by

MIRUS International Inc.

31 Sun Pac Boulevard, Brampton, ON, Canada L6S 5P6 Tel:(905) 494-1120 Fax: (905) 494-1140 Toll Free: 1-888-TO MIRUS

Approved by - date

Scale

dimensions are in inches and [mm]. WXY 26-0	Unless otherwise specified,	,	Date
	dimensions are in inches and [mm].	WXY	26-0

26-0CT-09 YM YM - 26-0CT-09 NTS

Title 20HP 600V 60Hz

The information contained herein is the sole property of MIRUS International Inc. Any form of reproduction, distribution and/or disclosure of this information, all or in part, is strictly prohibited without the express written consent of MIRUS International Inc.

Panel Mount Style Lineator AUHF

Filename Revision Sheet AUHF-20-600-60-D-EOP-A22 A22 1/1