

Rev. No.	Revision Note	Date	Ву	Checked
A 11	REVISED TERMINALS	27 FEB 14	АН	YM
A12	REVISED TO PRESSURE PLATE STYLE	21-SEP-18	CG	BDK

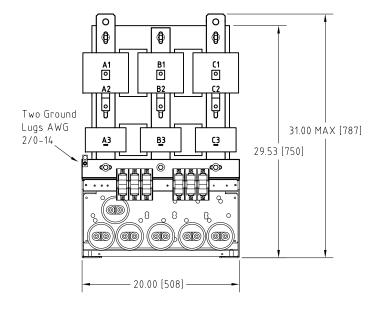


Front View




BOTTOM VIEW

NOTE:

This open style unit is not equipped with panel mount brackets. If panel mounting is desired, a suitable bracket must be provided by others.

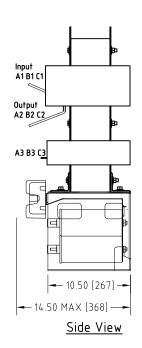


Connection Diagram



UNIT SPECIFICATIONS			INPUT OUTPUT APPROX. V			
HP [kW]	PHASE	VOLTS	Hz	AMPS	kW	lb [kg]
250 [185]	3	600	60	225	209	510 [232]

NOTES:

- 1. CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES AND OTHER APPLICABLE ELECTRICAL SAFETY AUTHORITIES.
- 2. CUSTOMER IS RESPONSIBLE FOR PROPER COOLING OF FILTER COMPONENTS. ALLOWED AMBIENT: MAXIMUM 60°C, MINIMUM -40°C. A MINIMUM CLEARANCE OF 2" MUST BE ALLOWED ON BOTH RIGHT AND LEFT SIDES. PROPER VENTILATION MUST ENSURE THAT SUPPLY AIR FLOWS THROUGH THE REACTOR COILS FROM BELOW THE UNIT.



Input A1,B1,C1 & Output A2,B2,C2 TERMINALS THICKNESS 1/4"

MIRUS International Inc.

31 Sun Pac Boulevard, Brampton, ON, Canada L6S 5P6 Tel:(905) 494-1120 Fax: (905) 494-1140 Toll Free: 1-888-TO MIRUS

Unless otherwise specified,	Drawn By	Date Created	Checked by	Approved by - date	Scale	l
dimensions are in inches and [mm].	EH	22-Jun-06	YM	YM-22-Jun-06	NTS	

The information contained herein is the sole property of MIRUS International Inc. Any form of reproduction, distribution and/or disclosure of this information, all or in part, is strictly prohibited without the express written consent of MIRUS International Inc.

Title 250 HP, 600 V, 60 Hz LINEATOR™ AUHF (Open Style)

lename	Revision	Sheet
AUHF-250-600-60-D-E0-A12	A 12	1/1