



Rev. No.	Revision Note	Date	Ву	Checked
A1	Brackets Revised	04-FEB-14	АН	YM

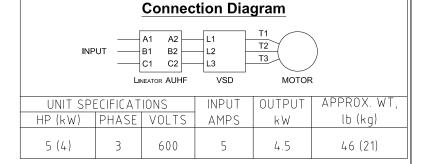

## NOTES:

- 1. CUSTOMER IS RESPONSIBLE FOR INSTALLATION TO MEET ALL NATIONAL AND LOCAL ELECTRICAL CODES AND OTHER APPLICABLE ELECTRICAL SAFETY AUTHORITIES.
- 2. CUSTOMER IS RESPONSIBLE FOR PROPER COOLING OF FILTER COMPONENTS. ALLOWED AMBIENT: MAXIMUM 60°C, MINIMUM -40°C. A MINIMUM CLEARANCE OF 2" MUST BE ALLOWED ON BOTH RIGHT AND LEFT SIDES. PROPER VENTILATION MUST ENSURE THAT SUPPLY AIR FLOWS THROUGH THE REACTOR COILS FROM BELOW THE UNIT.



Input A1,B1,C1 & Output A2,B2,C2
TERMINALS
THICKNESS: 1/8"

MIRUS Internation	31 Sun Pac Boulevard, Brampton, ON, Canada L6S 5P6 Tel:(905) 494–1120 Fax: (905) 494–1140 Toll Free: 1–888–TO MIRUS						
Unless otherwise specified, dimensions are in inches and [mm].	Drawn by WXY	Date 22-0CT-09	· '	Approved b YM - 22-	,	Scale NTS	
The information contained herein is the sole property of MIRUS International Inc. Any form of reproduction, distribution and/or disclosure of this information, all or in part, is strictly prohibited		Title 5HP, 600V, 60Hz Lineator AUHF (Open Style)					
without the express written consent of M		rilename	)-60-D-E0-A1		Revision A1	Sheet 1/1	